


Glyntaff Solar Farm

Glyntaff Solar Farm Road 5 Degrees

Created Feb 11, 2025
 Updated Feb 25, 2025
 Time-step 1 minute
 Timezone offset UTC0
 Minimum sun altitude 0.0 deg
 Site ID 141086.23859

Project type Advanced
 Project status: active
 Category 10 MW to 100 MW

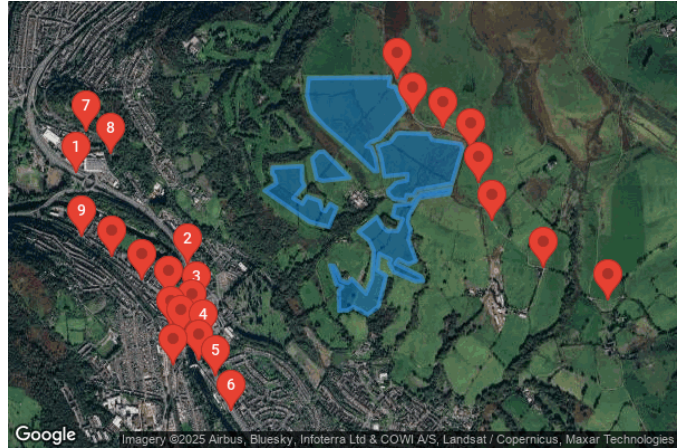

Misc. Analysis Settings

DNI: varies (1,000.0 W/m² peak)
 Ocular transmission coefficient: 0.5
 Pupil diameter: 0.002 m
 Eye focal length: 0.017 m
 Sun subtended angle: 9.3 mrad

PV Analysis Methodology: **Version 2**
 Enhanced subtended angle calculation: **On**

Summary of Results Glare with potential for temporary after-image predicted

PV Name	Tilt	Orientation	"Green" Glare	"Yellow" Glare	Energy Produced
	deg	deg	min	min	kWh
PV array 1	5.0	180.0	12,911	0	-
PV array 2	5.0	180.0	15,272	0	-
PV array 3	5.0	180.0	68,106	39,949	-
PV array 4	5.0	180.0	10,383	8,626	-
PV array 5	5.0	180.0	17,801	2,418	-

Component Data

PV Array(s)

Total PV footprint area: 424,331 m²

Name: PV array 1
Footprint area: 17,880 m²
Axis tracking: Fixed (no rotation)
Tilt: 5.0 deg
Orientation: 180.0 deg
Rated power: -
Panel material: Light textured glass with AR coating
Vary reflectivity with sun position? Yes
Correlate slope error with surface type? Yes
Slope error: 9.16 mrad



Vertex	Latitude	Longitude	Ground elevation	Height above ground	Total elevation
	deg	deg	m	m	m
1	51.601938	-3.313555	265.09	3.00	268.09
2	51.601611	-3.314070	259.47	3.00	262.47
3	51.600658	-3.313716	254.63	3.00	257.63
4	51.600565	-3.313266	256.31	3.00	259.31
5	51.600705	-3.311184	256.66	3.00	259.66
6	51.601965	-3.313169	266.61	3.00	269.61

Name: PV array 2
Footprint area: 49,551 m²
Axis tracking: Fixed (no rotation)
Tilt: 5.0 deg
Orientation: 180.0 deg
Rated power: -
Panel material: Light textured glass with AR coating
Vary reflectivity with sun position? Yes
Correlate slope error with surface type? Yes
Slope error: 9.16 mrad



Vertex	Latitude	Longitude	Ground elevation	Height above ground	Total elevation
	deg	deg	m	m	m
1	51.601265	-3.314843	244.83	3.00	247.83
2	51.600558	-3.314854	236.32	3.00	239.32
3	51.600339	-3.314671	235.55	3.00	238.55
4	51.599725	-3.315519	226.27	3.00	229.27
5	51.599466	-3.314800	226.21	3.00	229.21
6	51.599812	-3.314478	230.46	3.00	233.46
7	51.599606	-3.313491	234.07	3.00	237.07
8	51.599172	-3.313277	228.27	3.00	231.27
9	51.599112	-3.313062	228.90	3.00	231.90
10	51.599472	-3.312665	240.65	3.00	243.65
11	51.599279	-3.312193	238.25	3.00	241.25
12	51.598366	-3.312772	215.54	3.00	218.54
13	51.598613	-3.314285	217.43	3.00	220.43
14	51.600099	-3.317729	223.93	3.00	226.93
15	51.600439	-3.316828	230.35	3.00	233.35
16	51.600792	-3.316957	231.71	3.00	234.71
17	51.600925	-3.317150	232.30	3.00	235.30
18	51.601192	-3.317107	234.16	3.00	237.16

Name: PV array 3

Footprint area: 149,753 m²

Axis tracking: Fixed (no rotation)

Tilt: 5.0 deg

Orientation: 180.0 deg

Rated power: -

Panel material: Light textured glass with AR coating

Vary reflectivity with sun position? Yes

Correlate slope error with surface type? Yes

Slope error: 9.16 mrad



Vertex	Latitude	Longitude	Ground elevation	Height above ground	Total elevation
	deg	deg	m	m	m
1	51.605456	-3.314339	282.26	3.00	285.26
2	51.605503	-3.308062	317.40	3.00	320.40
3	51.605236	-3.308116	315.98	3.00	318.98
4	51.605090	-3.308159	315.21	3.00	318.21
5	51.605043	-3.307687	319.87	3.00	322.87
6	51.603977	-3.306914	319.05	3.00	322.05
7	51.602578	-3.308846	300.16	3.00	303.16
8	51.602398	-3.309618	297.80	3.00	300.80
9	51.602211	-3.309897	295.43	3.00	298.43
10	51.602165	-3.309532	294.68	3.00	297.68
11	51.601691	-3.309221	289.06	3.00	292.06
12	51.601018	-3.309028	283.77	3.00	286.77
13	51.601018	-3.309307	283.85	3.00	286.85
14	51.602118	-3.311131	292.67	3.00	295.67
15	51.603171	-3.313105	292.60	3.00	295.60
16	51.603870	-3.314135	286.52	3.00	289.52
17	51.604637	-3.314467	283.17	3.00	286.17

Name: PV array 4

Footprint area: 106,771 m²

Axis tracking: Fixed (no rotation)

Tilt: 5.0 deg

Orientation: 180.0 deg

Rated power: -

Panel material: Light textured glass with AR coating

Vary reflectivity with sun position? Yes

Correlate slope error with surface type? Yes

Slope error: 9.16 mrad



Vertex	Latitude	Longitude	Ground elevation	Height above ground	Total elevation
	deg	deg	m	m	m
1	51.602218	-3.309039	295.46	3.00	298.46
2	51.602418	-3.308041	301.51	3.00	304.51
3	51.602824	-3.307537	304.80	3.00	307.80
4	51.602844	-3.307118	307.70	3.00	310.70
5	51.602804	-3.305101	317.41	3.00	320.41
6	51.602518	-3.304822	314.60	3.00	317.60
7	51.602324	-3.302623	322.20	3.00	325.20
8	51.602111	-3.302505	319.44	3.00	322.44
9	51.600439	-3.303320	299.07	3.00	302.07
10	51.600132	-3.306024	284.88	3.00	287.88
11	51.599872	-3.306260	280.94	3.00	283.94
12	51.599885	-3.306796	279.08	3.00	282.08
13	51.599646	-3.306893	276.48	3.00	279.48
14	51.599699	-3.307794	274.05	3.00	277.05
15	51.599932	-3.308180	273.69	3.00	276.69
16	51.600105	-3.308234	275.93	3.00	278.93
17	51.600465	-3.307633	281.09	3.00	284.09
18	51.600592	-3.306764	286.62	3.00	289.62
19	51.600885	-3.306732	289.59	3.00	292.59
20	51.600778	-3.308513	281.54	3.00	284.54
21	51.601651	-3.308749	288.49	3.00	291.49

Name: PV array 5

Footprint area: 100,376 m²

Axis tracking: Fixed (no rotation)

Tilt: 5.0 deg

Orientation: 180.0 deg

Rated power: -

Panel material: Light textured glass with AR coating

Vary reflectivity with sun position? Yes

Correlate slope error with surface type? Yes

Slope error: 9.16 mrad



Vertex	Latitude	Longitude	Ground elevation	Height above ground	Total elevation
	deg	deg	m	m	m
1	51.600205	-3.303385	294.90	3.00	297.90
2	51.599945	-3.303513	290.50	3.00	293.50
3	51.599745	-3.305852	282.14	3.00	285.14
4	51.598906	-3.306614	269.30	3.00	272.30
5	51.598566	-3.306710	263.61	3.00	266.61
6	51.598233	-3.306474	257.58	3.00	260.58
7	51.597766	-3.306657	245.68	3.00	248.68
8	51.596740	-3.306067	230.77	3.00	233.77
9	51.596587	-3.306646	229.73	3.00	232.73
10	51.596820	-3.307419	229.75	3.00	232.75
11	51.596626	-3.307655	225.39	3.00	228.39
12	51.596007	-3.305691	215.67	3.00	218.67
13	51.595787	-3.305509	211.16	3.00	214.16
14	51.595773	-3.306131	209.75	3.00	212.75
15	51.596213	-3.307783	216.75	3.00	219.75
16	51.596613	-3.308148	221.38	3.00	224.38
17	51.596806	-3.308009	225.93	3.00	228.93
18	51.597086	-3.308899	221.68	3.00	224.68
19	51.596300	-3.309049	203.96	3.00	206.96
20	51.596033	-3.308373	204.56	3.00	207.56
21	51.594560	-3.308953	170.18	3.00	173.18
22	51.594180	-3.309811	160.65	3.00	163.65
23	51.594547	-3.310884	160.99	3.00	163.99
24	51.594387	-3.311378	157.73	3.00	160.73
25	51.594360	-3.312000	154.10	3.00	157.10
26	51.595314	-3.312021	171.30	3.00	174.30
27	51.595507	-3.311753	175.53	3.00	178.53
28	51.595613	-3.312204	174.41	3.00	177.41
29	51.596533	-3.312686	187.07	3.00	190.07
30	51.596493	-3.312354	189.19	3.00	192.19
31	51.595800	-3.311839	180.50	3.00	183.50
32	51.595693	-3.311313	180.82	3.00	183.82
33	51.595887	-3.311023	185.16	3.00	188.16
34	51.595180	-3.309918	180.13	3.00	183.13
35	51.595893	-3.309457	195.26	3.00	198.26
36	51.597226	-3.309328	219.20	3.00	222.20
37	51.597703	-3.309666	224.92	3.00	227.92
38	51.598126	-3.310492	226.04	3.00	229.04
39	51.598839	-3.309071	247.64	3.00	250.64
40	51.598363	-3.308652	242.13	3.00	245.13
41	51.598176	-3.308304	242.91	3.00	245.91
42	51.598176	-3.307494	250.43	3.00	253.43
43	51.598732	-3.307086	265.32	3.00	268.32
44	51.598872	-3.307864	264.95	3.00	267.95
45	51.599396	-3.307681	271.60	3.00	274.60
46	51.599479	-3.306415	276.33	3.00	279.33
47	51.599942	-3.305723	285.01	3.00	288.01

Discrete Observation Receptors

Number	Latitude	Longitude	Ground elevation	Height above ground	Total Elevation
	deg	deg	m	m	m
OP 1	51.600911	-3.332208	55.86	1.50	57.36
OP 2	51.596560	-3.323595	59.65	1.50	61.15
OP 3	51.594708	-3.322973	56.25	1.50	57.75
OP 4	51.592888	-3.322404	58.02	1.50	59.52
OP 5	51.591228	-3.321438	53.37	1.50	54.87
OP 6	51.589549	-3.320269	52.92	1.50	54.42
OP 7	51.602895	-3.331438	75.18	1.50	76.68
OP 8	51.601802	-3.329549	69.37	1.50	70.87
OP 9	51.597870	-3.331792	59.04	1.50	60.54
OP 10	51.596927	-3.329447	57.51	1.50	59.01
OP 11	51.595787	-3.327162	56.51	1.50	58.01
OP 12	51.594998	-3.325059	55.02	1.50	56.52
OP 13	51.593848	-3.323305	54.72	1.50	56.22
OP 14	51.591938	-3.322753	53.14	1.50	54.64
OP 15	51.593538	-3.324872	64.90	1.50	66.40
OP 16	51.591735	-3.324770	63.20	1.50	64.70
OP 17	51.593101	-3.324115	57.24	1.50	58.74
OP 18	51.594841	-3.291237	238.68	1.50	240.18
OP 19	51.596374	-3.296236	247.40	1.50	248.90
OP 20	51.598640	-3.300195	281.81	1.50	283.31
OP 21	51.600406	-3.301215	305.33	1.50	306.83
OP 22	51.602025	-3.301805	323.79	1.50	325.29
OP 23	51.603031	-3.303983	329.78	1.50	331.28
OP 24	51.603758	-3.306321	324.45	1.50	325.95
OP 25	51.605367	-3.307524	324.07	1.50	325.57

Summary of PV Glare Analysis

PV configuration and total predicted glare

PV Name	Tilt	Orientation	"Green" Glare	"Yellow" Glare	Energy Produced	Data File
	deg	deg	min	min	kWh	
PV array 1	5.0	180.0	12,911	0	-	-
PV array 2	5.0	180.0	15,272	0	-	-
PV array 3	5.0	180.0	68,106	39,949	-	-
PV array 4	5.0	180.0	10,383	8,626	-	-
PV array 5	5.0	180.0	17,801	2,418	-	-

Distinct glare per month

Excludes overlapping glare from PV array for multiple receptors at matching time(s)

PV	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
pv-array-1 (green)	977	987	961	672	412	29	290	559	841	1082	988	925
pv-array-1 (yellow)	0	0	0	0	0	0	0	0	0	0	0	0
pv-array-2 (green)	978	779	751	680	248	0	73	575	738	826	920	1007
pv-array-2 (yellow)	0	0	0	0	0	0	0	0	0	0	0	0
pv-array-3 (green)	4098	3187	2231	2541	3459	3580	3595	2932	2290	2790	4070	3876
pv-array-3 (yellow)	2414	1846	1753	1196	1635	1595	1670	1293	1546	1929	2236	2577
pv-array-4 (green)	300	320	588	115	112	126	126	111	457	394	306	320
pv-array-4 (yellow)	945	944	660	154	6	70	3	87	348	1062	960	792
pv-array-5 (green)	371	582	623	592	377	235	309	525	693	619	400	264
pv-array-5 (yellow)	130	68	163	0	0	0	0	0	18	155	89	395

PV & Receptor Analysis Results

Results for each PV array and receptor

PV array 1 low potential for temporary after-image

Component	Green glare (min)	Yellow glare (min)
OP: OP 1	0	0
OP: OP 2	0	0
OP: OP 3	0	0
OP: OP 4	0	0
OP: OP 5	0	0
OP: OP 6	0	0
OP: OP 7	0	0
OP: OP 8	0	0
OP: OP 9	0	0
OP: OP 10	0	0
OP: OP 11	0	0
OP: OP 12	0	0
OP: OP 13	0	0
OP: OP 14	0	0
OP: OP 15	0	0
OP: OP 16	0	0

OP: OP 17	0	0
OP: OP 18	876	0
OP: OP 19	983	0
OP: OP 20	0	0
OP: OP 21	1410	0
OP: OP 22	1780	0
OP: OP 23	2897	0
OP: OP 24	4348	0
OP: OP 25	617	0

PV array 1: OP 1

No glare found

PV array 1: OP 2

No glare found

PV array 1: OP 3

No glare found

PV array 1: OP 4

No glare found

PV array 1: OP 5

No glare found

PV array 1: OP 6

No glare found

PV array 1: OP 7

No glare found

PV array 1: OP 8

No glare found

PV array 1: OP 9

No glare found

PV array 1: OP 10

No glare found

PV array 1: OP 11

No glare found

PV array 1: OP 12

No glare found

PV array 1: OP 13

No glare found

PV array 1: OP 14

No glare found

PV array 1: OP 15

No glare found

PV array 1: OP 16

No glare found





PV array 1: OP 17

No glare found

PV array 1: OP 18

PV array is expected to produce the following glare for this receptor:





- 876 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

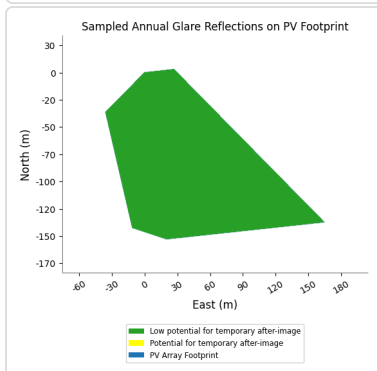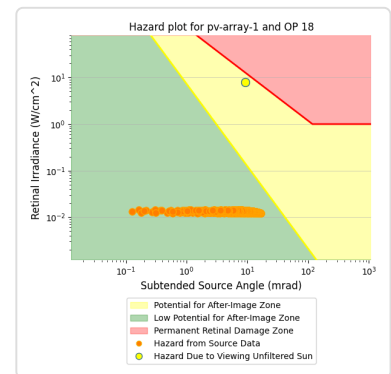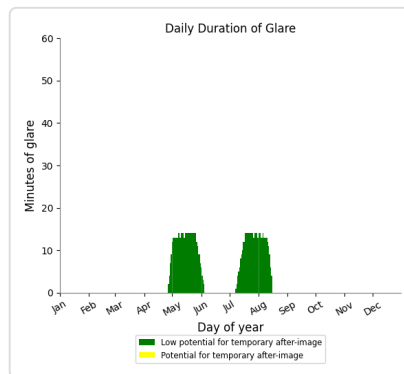

PV array 1: OP 19

PV array is expected to produce the following glare for this receptor:

- 983 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

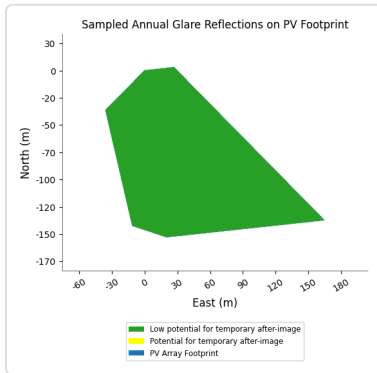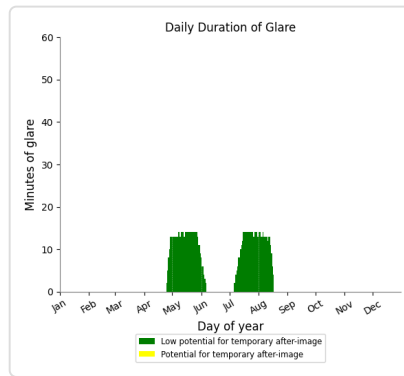





PV array 1: OP 20

No glare found

PV array 1: OP 21

PV array is expected to produce the following glare for this receptor:





- 1,410 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

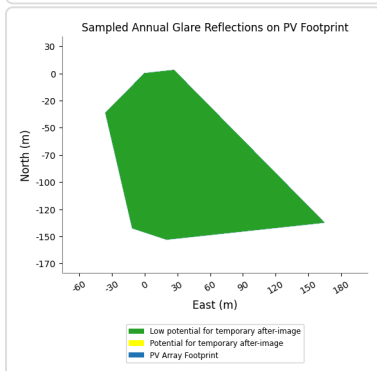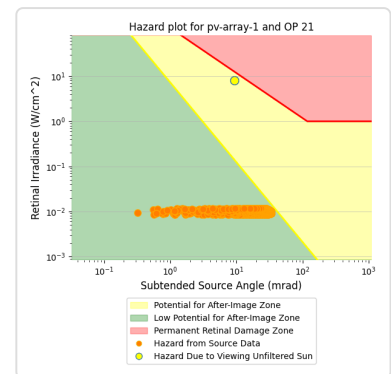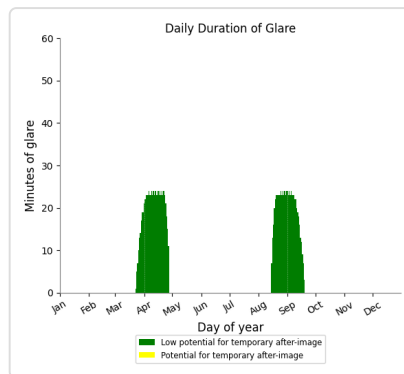

PV array 1: OP 22

PV array is expected to produce the following glare for this receptor:





- 1,780 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

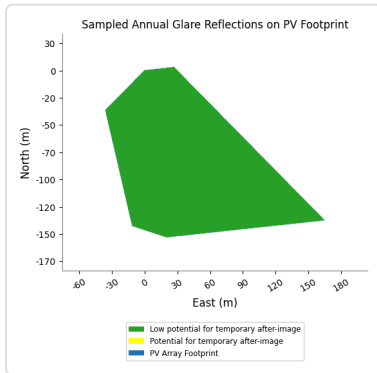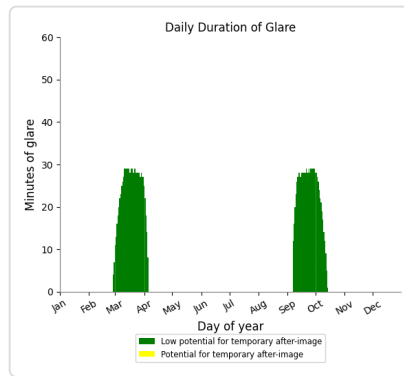

PV array 1: OP 23

PV array is expected to produce the following glare for this receptor:





- 2,897 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

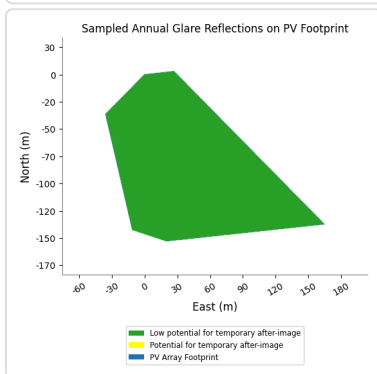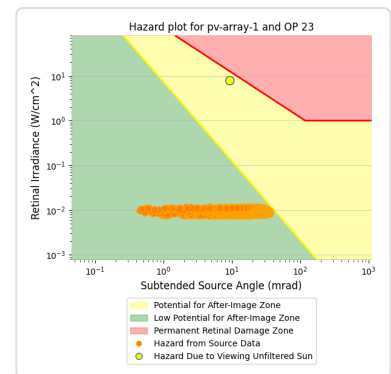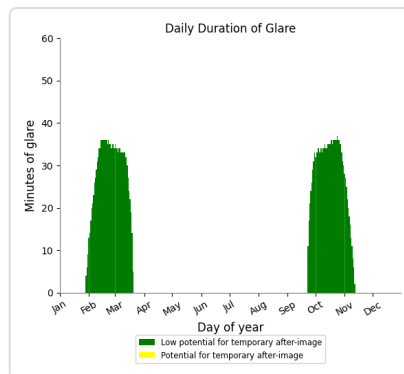

PV array 1: OP 24

PV array is expected to produce the following glare for this receptor:





- 4,348 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

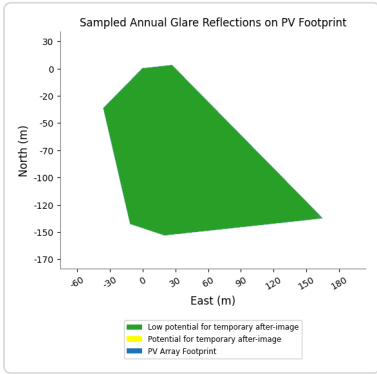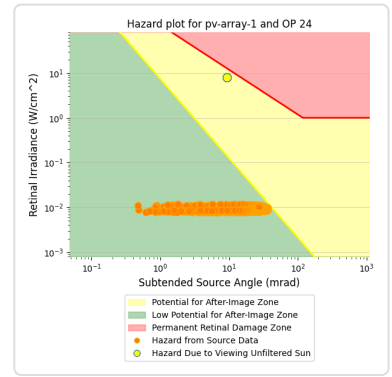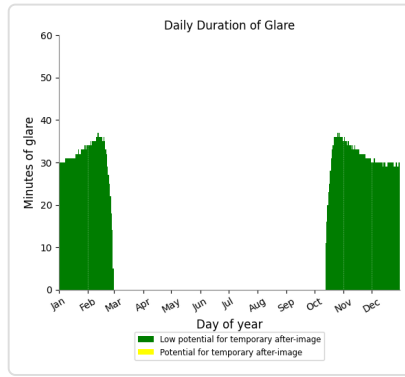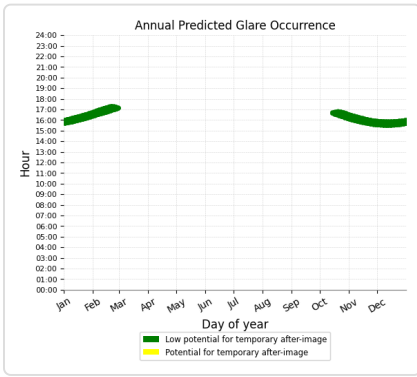

PV array 1: OP 25

PV array is expected to produce the following glare for this receptor:

- 617 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

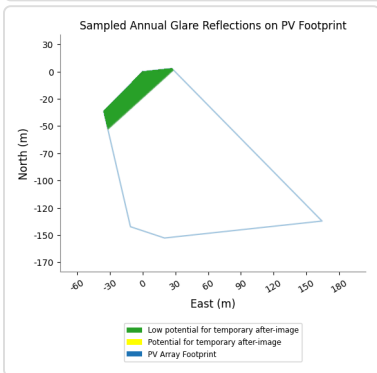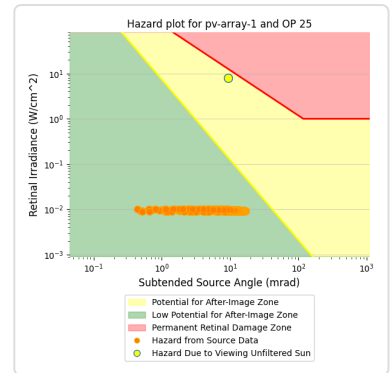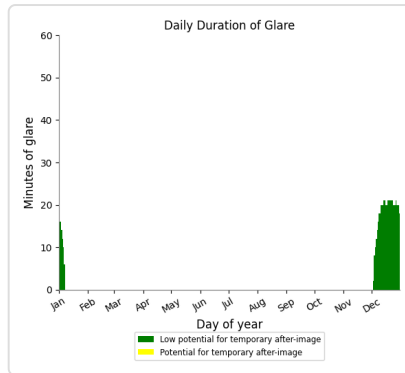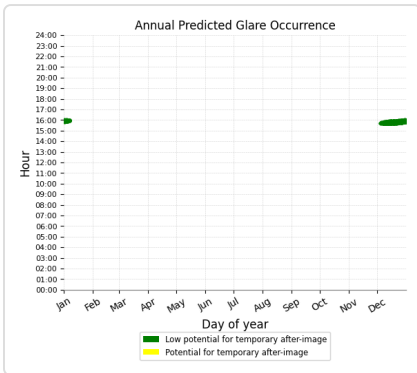

PV array 2 low potential for temporary after-image

Component	Green glare (min)	Yellow glare (min)
-----------	-------------------	--------------------

OP: OP 1	0	0
OP: OP 2	0	0
OP: OP 3	0	0
OP: OP 4	0	0
OP: OP 5	0	0
OP: OP 6	0	0
OP: OP 7	0	0
OP: OP 8	0	0
OP: OP 9	0	0
OP: OP 10	0	0
OP: OP 11	0	0
OP: OP 12	0	0
OP: OP 13	0	0
OP: OP 14	0	0
OP: OP 15	0	0
OP: OP 16	0	0
OP: OP 17	0	0
OP: OP 18	1009	0
OP: OP 19	1173	0
OP: OP 20	0	0
OP: OP 21	2060	0
OP: OP 22	2424	0
OP: OP 23	4454	0
OP: OP 24	4077	0
OP: OP 25	75	0

PV array 2: OP 1

No glare found

PV array 2: OP 2

No glare found

PV array 2: OP 3

No glare found

PV array 2: OP 4

No glare found

PV array 2: OP 5

No glare found

PV array 2: OP 6

No glare found

PV array 2: OP 7

No glare found

PV array 2: OP 8

No glare found

PV array 2: OP 9

No glare found

PV array 2: OP 10

No glare found

PV array 2: OP 11

No glare found

PV array 2: OP 12

No glare found

PV array 2: OP 13

No glare found

PV array 2: OP 14

No glare found

PV array 2: OP 15

No glare found

PV array 2: OP 16

No glare found





PV array 2: OP 17

No glare found

PV array 2: OP 18

PV array is expected to produce the following glare for this receptor:





- 1,009 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

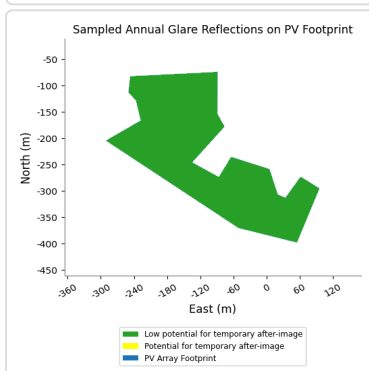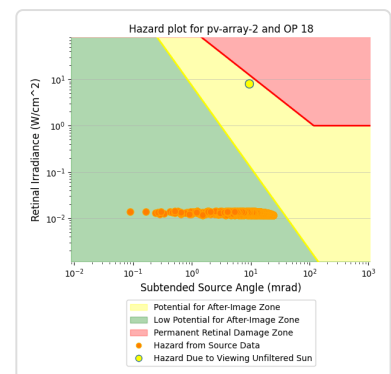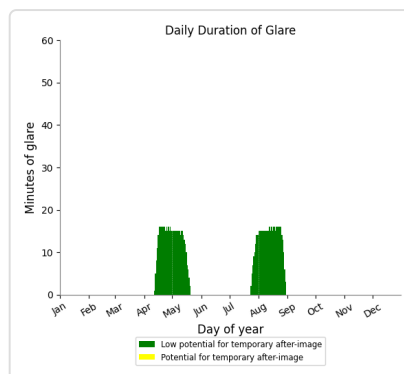

PV array 2: OP 19

PV array is expected to produce the following glare for this receptor:

- 1,173 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

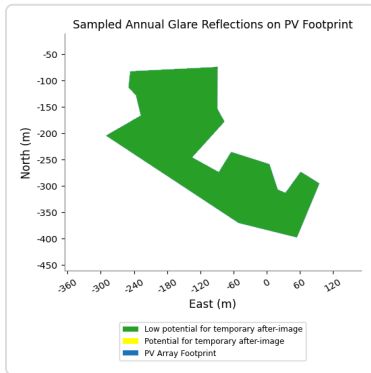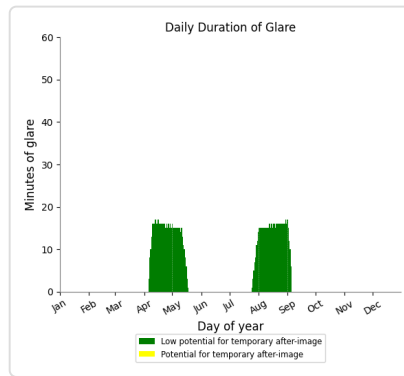





PV array 2: OP 20

No glare found

PV array 2: OP 21

PV array is expected to produce the following glare for this receptor:





- 2,060 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

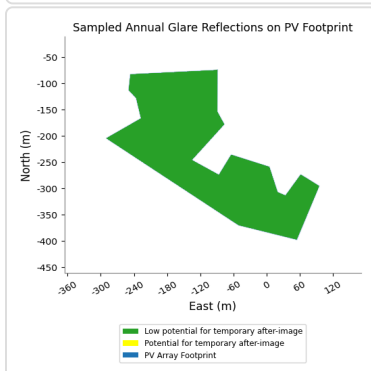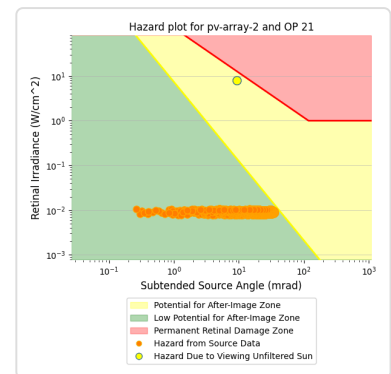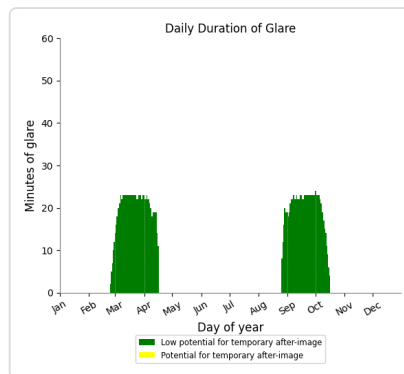

PV array 2: OP 22

PV array is expected to produce the following glare for this receptor:





- 2,424 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

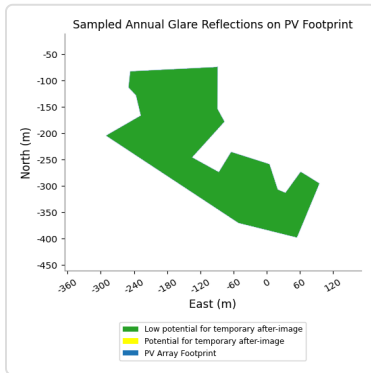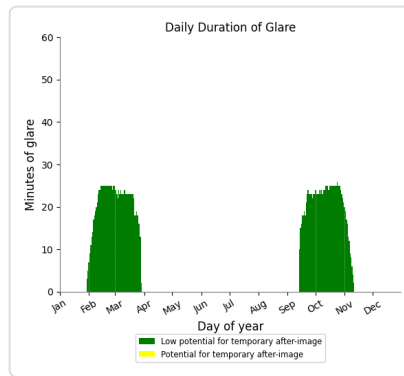

PV array 2: OP 23

PV array is expected to produce the following glare for this receptor:





- 4,454 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

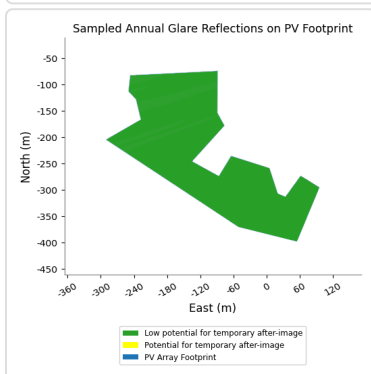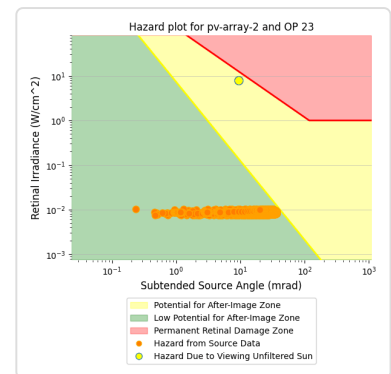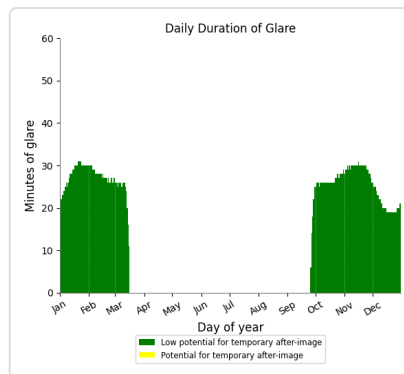

PV array 2: OP 24

PV array is expected to produce the following glare for this receptor:





- 4,077 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

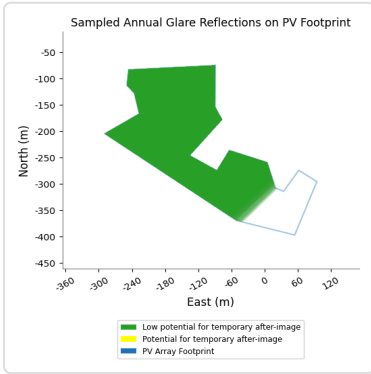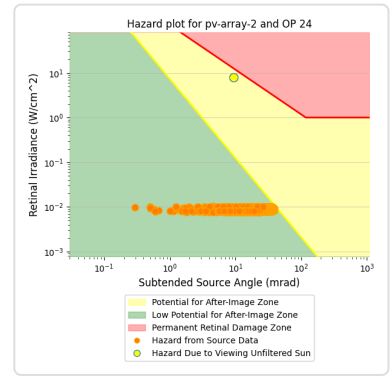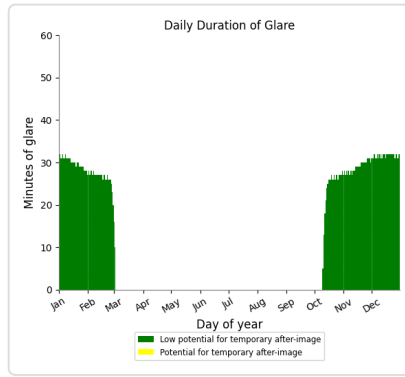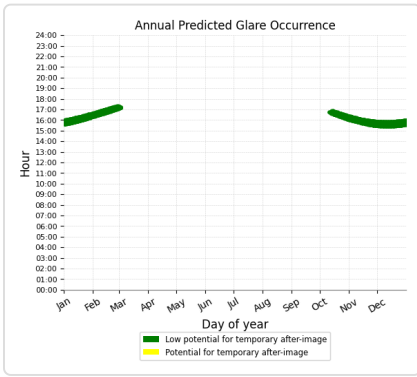

PV array 2: OP 25

PV array is expected to produce the following glare for this receptor:

- 75 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

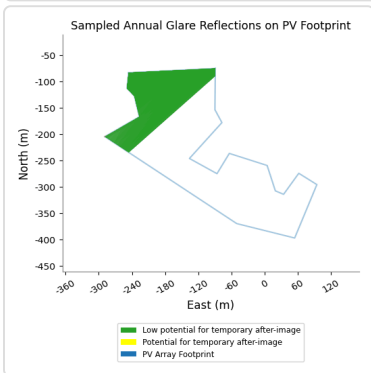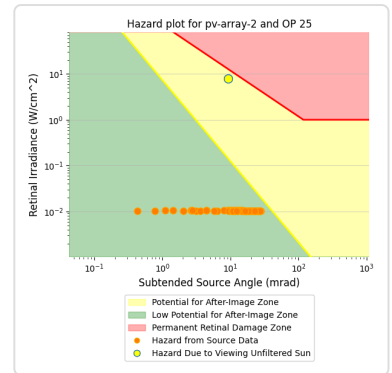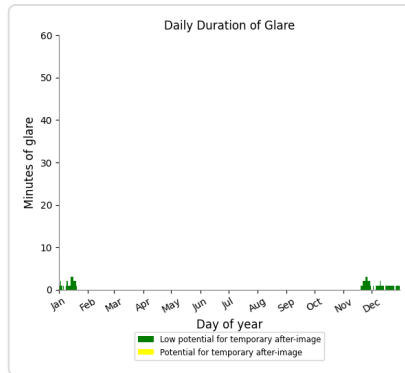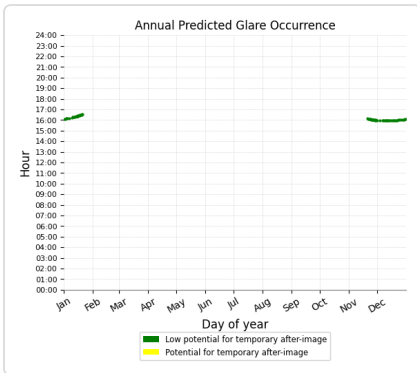

PV array 3 potential temporary after-image

Component	Green glare (min)	Yellow glare (min)
-----------	-------------------	--------------------

OP: OP 1	0	0
OP: OP 2	0	0
OP: OP 3	0	0
OP: OP 4	0	0
OP: OP 5	0	0
OP: OP 6	0	0
OP: OP 7	0	0
OP: OP 8	0	0
OP: OP 9	0	0
OP: OP 10	0	0
OP: OP 11	0	0
OP: OP 12	0	0
OP: OP 13	0	0
OP: OP 14	0	0
OP: OP 15	0	0
OP: OP 16	0	0
OP: OP 17	0	0
OP: OP 18	1504	0
OP: OP 19	1393	0
OP: OP 20	2068	0
OP: OP 21	0	0
OP: OP 22	2877	3414
OP: OP 23	6157	6668
OP: OP 24	17817	14792
OP: OP 25	36290	15075

PV array 3: OP 1

No glare found

PV array 3: OP 2

No glare found

PV array 3: OP 3

No glare found

PV array 3: OP 4

No glare found

PV array 3: OP 5

No glare found

PV array 3: OP 6

No glare found

PV array 3: OP 7

No glare found

PV array 3: OP 8

No glare found

PV array 3: OP 9

No glare found

PV array 3: OP 10

No glare found

PV array 3: OP 11

No glare found

PV array 3: OP 12

No glare found

PV array 3: OP 13

No glare found

PV array 3: OP 14

No glare found

PV array 3: OP 15

No glare found

PV array 3: OP 16

No glare found





PV array 3: OP 17

No glare found

PV array 3: OP 18

PV array is expected to produce the following glare for this receptor:





- 1,504 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

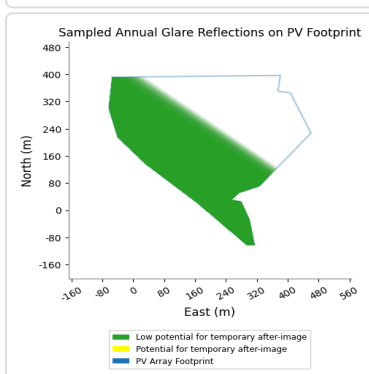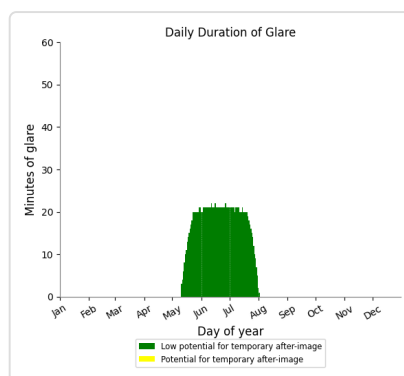

PV array 3: OP 19

PV array is expected to produce the following glare for this receptor:





- 1,393 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

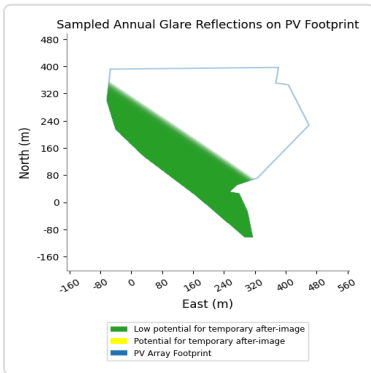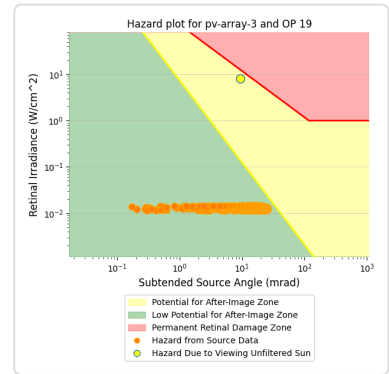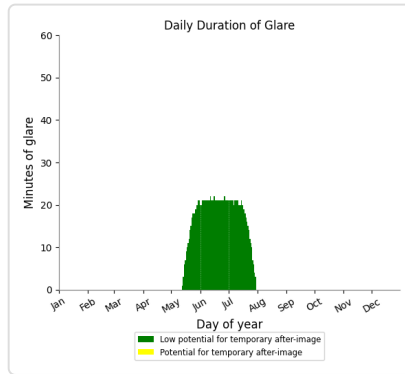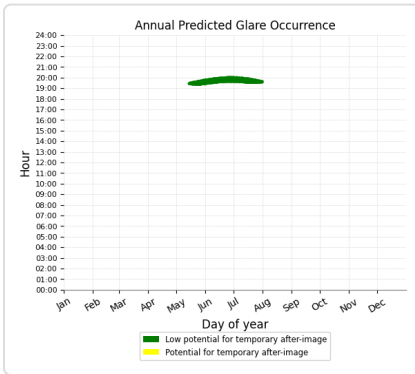

PV array 3: OP 20

PV array is expected to produce the following glare for this receptor:

- 2,068 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

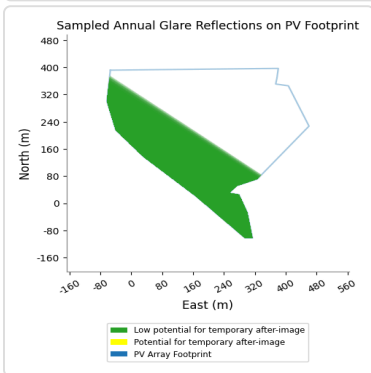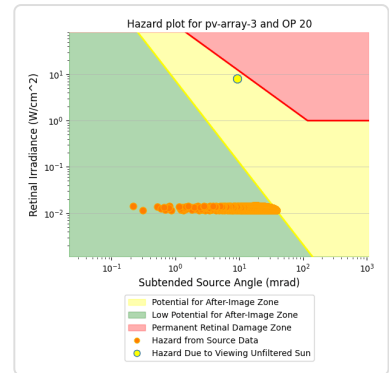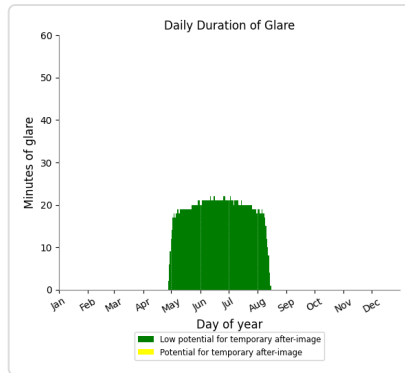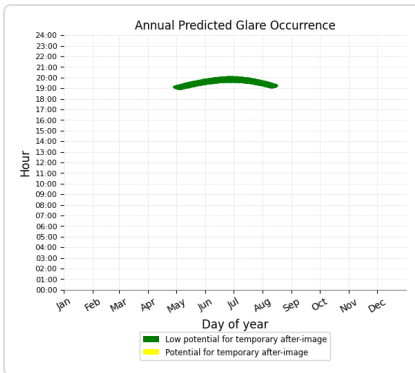





PV array 3: OP 21

No glare found

PV array 3: OP 22

PV array is expected to produce the following glare for this receptor:





- 2,877 minutes of "green" glare with low potential to cause temporary after-image.
- 3,414 minutes of "yellow" glare with potential to cause temporary after-image.

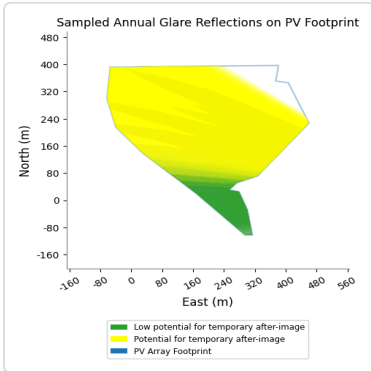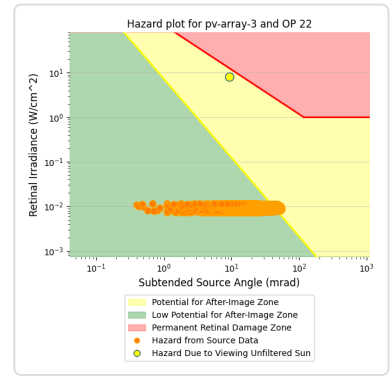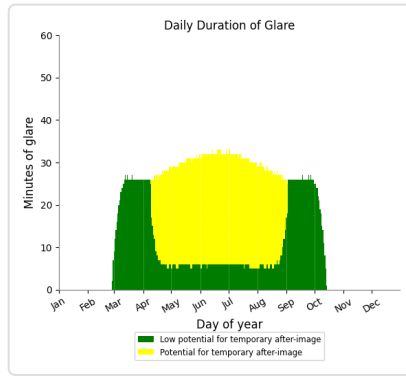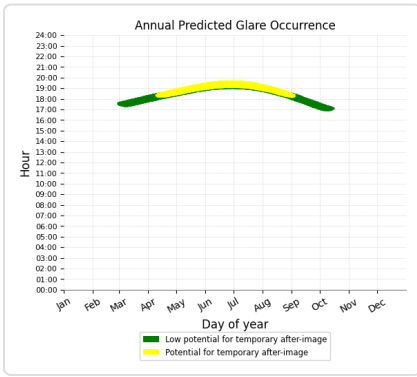

PV array 3: OP 23

PV array is expected to produce the following glare for this receptor:





- 6,157 minutes of "green" glare with low potential to cause temporary after-image.
- 6,668 minutes of "yellow" glare with potential to cause temporary after-image.

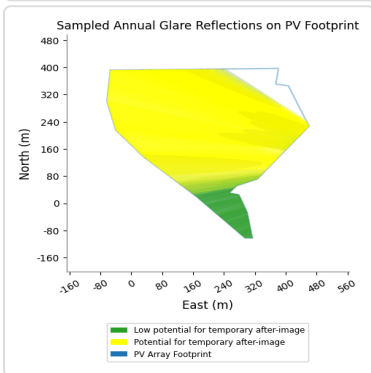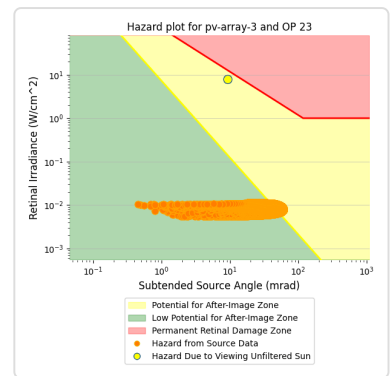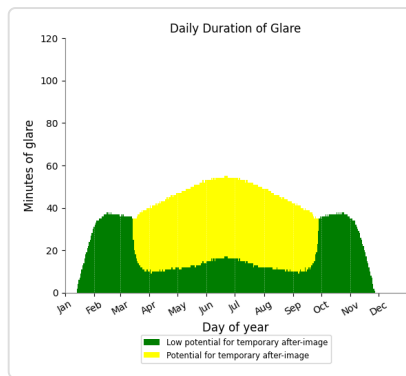

PV array 3: OP 24

PV array is expected to produce the following glare for this receptor:





- 17,817 minutes of "green" glare with low potential to cause temporary after-image.
- 14,792 minutes of "yellow" glare with potential to cause temporary after-image.

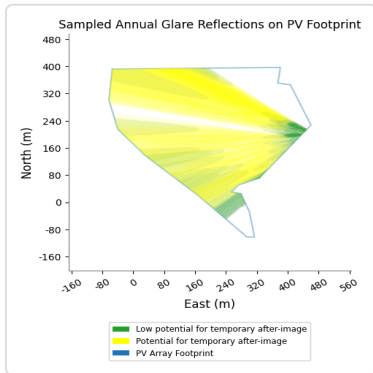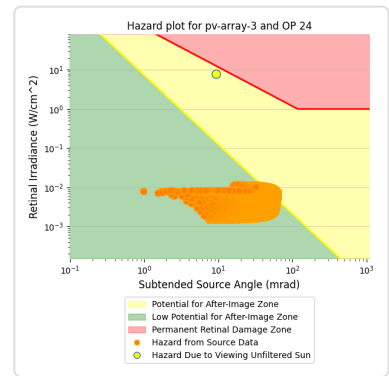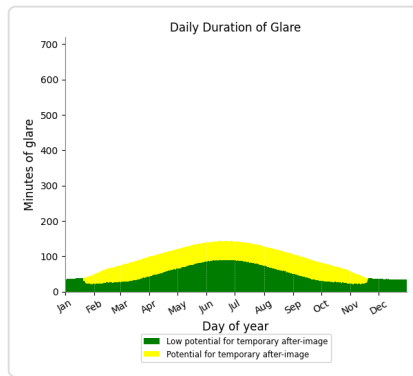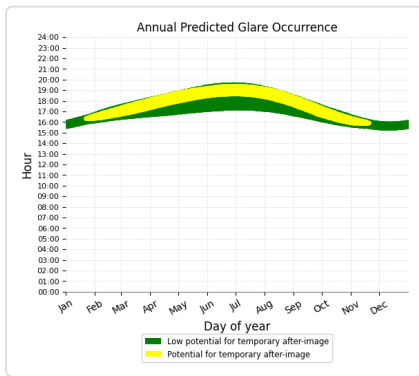

PV array 3: OP 25

PV array is expected to produce the following glare for this receptor:

- 36,290 minutes of "green" glare with low potential to cause temporary after-image.
- 15,075 minutes of "yellow" glare with potential to cause temporary after-image.

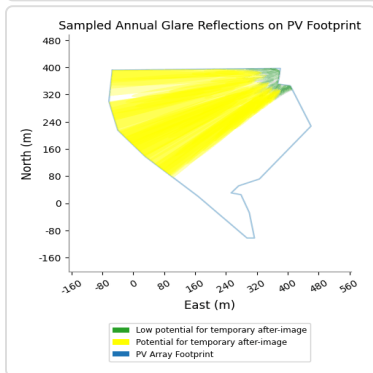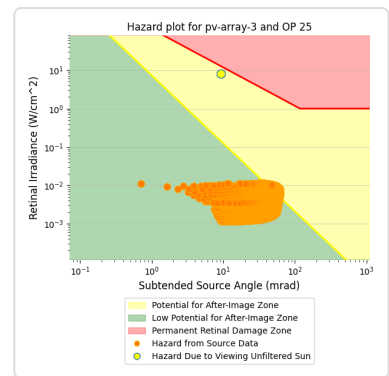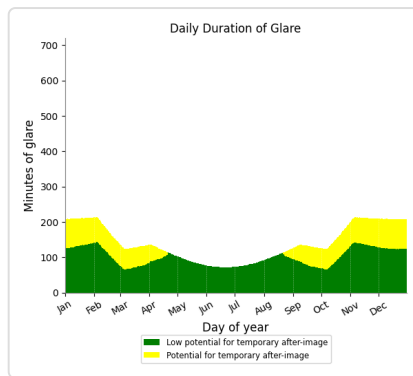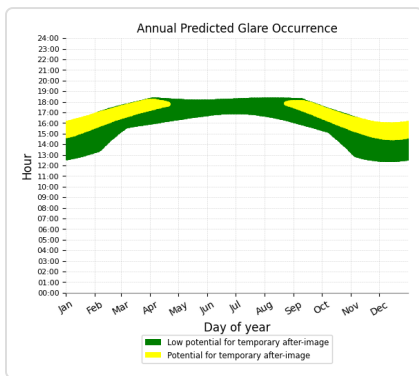

PV array 4 potential temporary after-image

Component	Green glare (min)	Yellow glare (min)
-----------	-------------------	--------------------

OP: OP 1	0	0
OP: OP 2	0	0
OP: OP 3	0	0
OP: OP 4	0	0
OP: OP 5	0	0
OP: OP 6	0	0
OP: OP 7	0	0
OP: OP 8	0	0
OP: OP 9	0	0
OP: OP 10	0	0
OP: OP 11	0	0
OP: OP 12	0	0
OP: OP 13	0	0
OP: OP 14	0	0
OP: OP 15	0	0
OP: OP 16	0	0
OP: OP 17	0	0
OP: OP 18	1290	0
OP: OP 19	1075	0
OP: OP 20	1752	336
OP: OP 21	1300	2062
OP: OP 22	2627	1054
OP: OP 23	2060	5174
OP: OP 24	279	0
OP: OP 25	0	0

PV array 4: OP 1

No glare found

PV array 4: OP 2

No glare found

PV array 4: OP 3

No glare found

PV array 4: OP 4

No glare found

PV array 4: OP 5

No glare found

PV array 4: OP 6

No glare found

PV array 4: OP 7

No glare found

PV array 4: OP 8

No glare found

PV array 4: OP 9

No glare found

PV array 4: OP 10

No glare found

PV array 4: OP 11

No glare found

PV array 4: OP 12

No glare found

PV array 4: OP 13

No glare found

PV array 4: OP 14

No glare found

PV array 4: OP 15

No glare found

PV array 4: OP 16

No glare found





PV array 4: OP 17

No glare found

PV array 4: OP 18

PV array is expected to produce the following glare for this receptor:





- 1,290 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

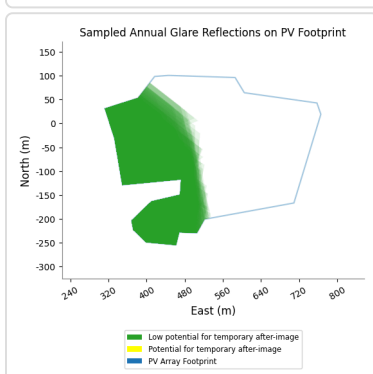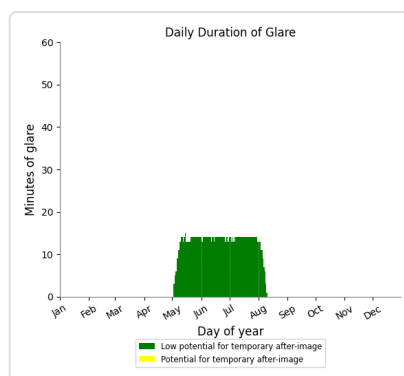

PV array 4: OP 19

PV array is expected to produce the following glare for this receptor:





- 1,075 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

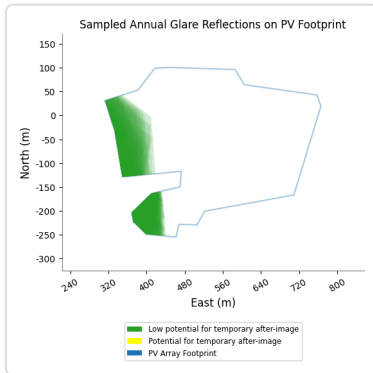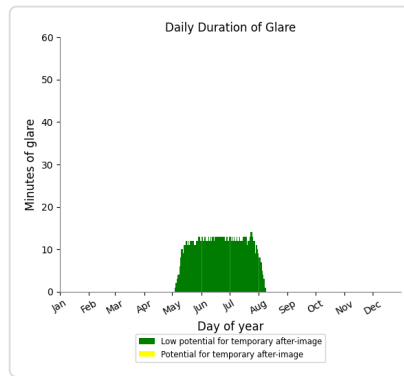

PV array 4: OP 20

PV array is expected to produce the following glare for this receptor:





- 1,752 minutes of "green" glare with low potential to cause temporary after-image.
- 336 minutes of "yellow" glare with potential to cause temporary after-image.

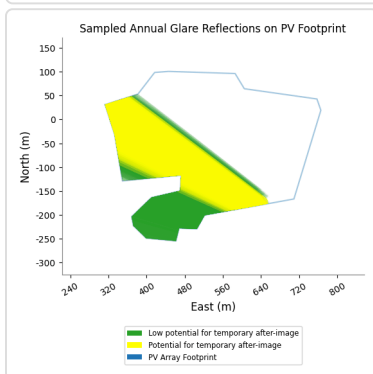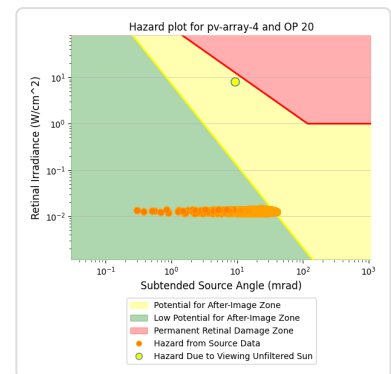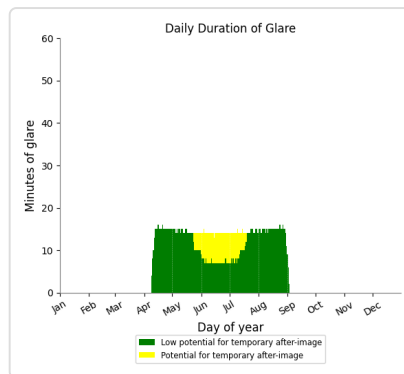

PV array 4: OP 21

PV array is expected to produce the following glare for this receptor:





- 1,300 minutes of "green" glare with low potential to cause temporary after-image.
- 2,062 minutes of "yellow" glare with potential to cause temporary after-image.

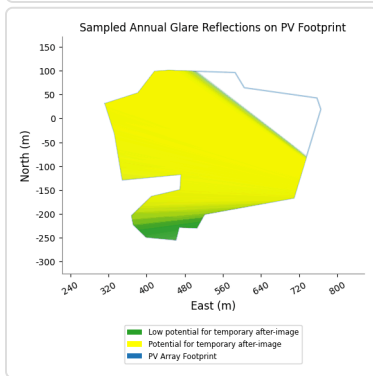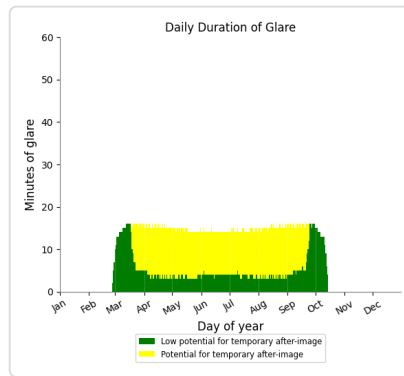

PV array 4: OP 22

PV array is expected to produce the following glare for this receptor:





- 2,627 minutes of "green" glare with low potential to cause temporary after-image.
- 1,054 minutes of "yellow" glare with potential to cause temporary after-image.

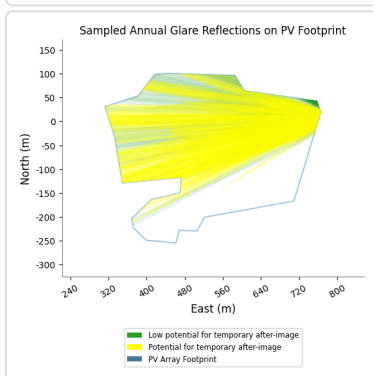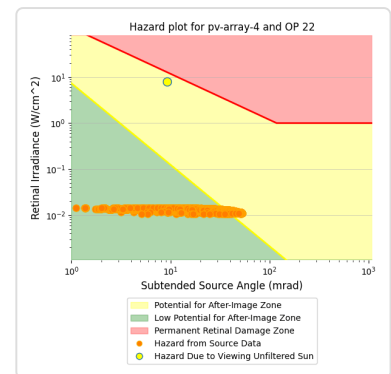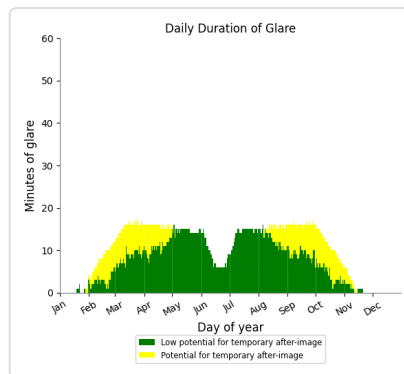

PV array 4: OP 23

PV array is expected to produce the following glare for this receptor:





- 2,060 minutes of "green" glare with low potential to cause temporary after-image.
- 5,174 minutes of "yellow" glare with potential to cause temporary after-image.

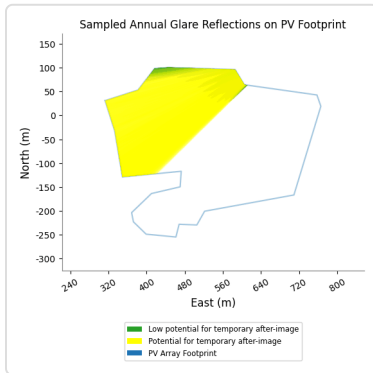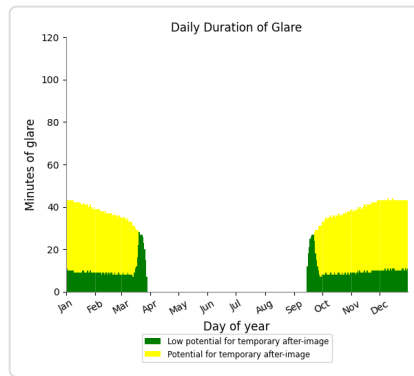

PV array 4: OP 24

PV array is expected to produce the following glare for this receptor:

- 279 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

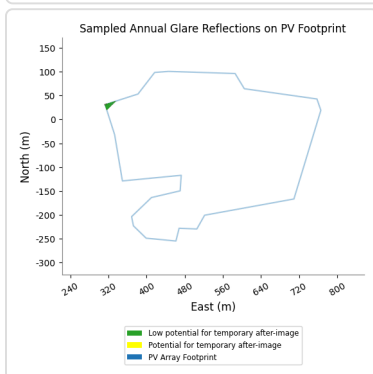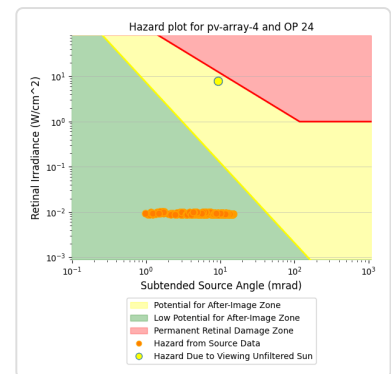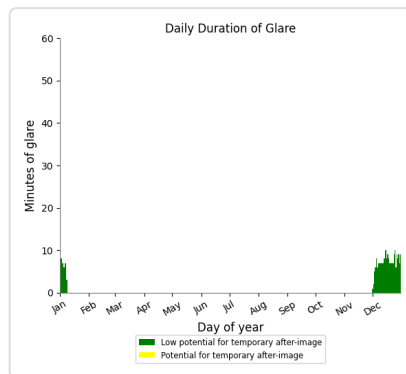

PV array 4: OP 25

No glare found

PV array 5 potential temporary after-image

Component	Green glare (min)	Yellow glare (min)
OP: OP 1	0	0
OP: OP 2	0	0
OP: OP 3	0	0
OP: OP 4	0	0
OP: OP 5	0	0
OP: OP 6	0	0
OP: OP 7	0	0
OP: OP 8	0	0
OP: OP 9	0	0
OP: OP 10	0	0
OP: OP 11	0	0
OP: OP 12	0	0
OP: OP 13	0	0
OP: OP 14	0	0
OP: OP 15	0	0
OP: OP 16	0	0
OP: OP 17	0	0
OP: OP 18	2968	0
OP: OP 19	3888	0
OP: OP 20	6758	391
OP: OP 21	2865	1494
OP: OP 22	1322	533
OP: OP 23	0	0
OP: OP 24	0	0
OP: OP 25	0	0

PV array 5: OP 1

No glare found

PV array 5: OP 2

No glare found

PV array 5: OP 3

No glare found

PV array 5: OP 4

No glare found

PV array 5: OP 5

No glare found

PV array 5: OP 6

No glare found

PV array 5: OP 7

No glare found

PV array 5: OP 8

No glare found

PV array 5: OP 9

No glare found

PV array 5: OP 10

No glare found

PV array 5: OP 11

No glare found

PV array 5: OP 12

No glare found

PV array 5: OP 13

No glare found

PV array 5: OP 14

No glare found

PV array 5: OP 15

No glare found

PV array 5: OP 16

No glare found





PV array 5: OP 17

No glare found

PV array 5: OP 18

PV array is expected to produce the following glare for this receptor:





- 2,968 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

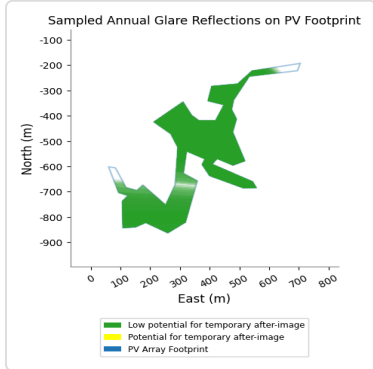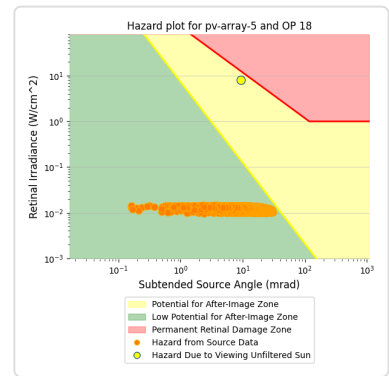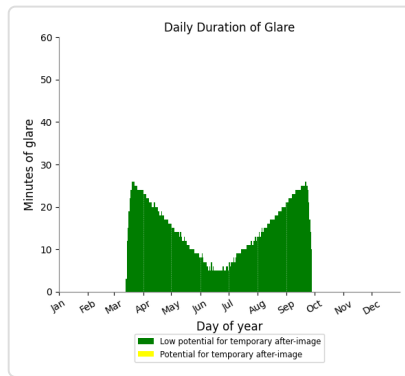

PV array 5: OP 19

PV array is expected to produce the following glare for this receptor:





- 3,888 minutes of "green" glare with low potential to cause temporary after-image.
- 0 minutes of "yellow" glare with potential to cause temporary after-image.

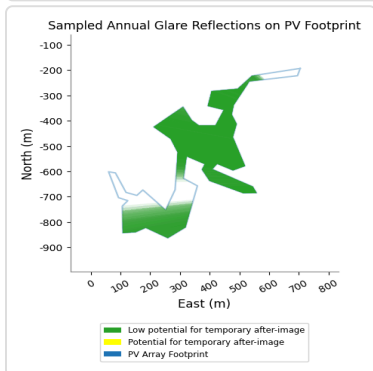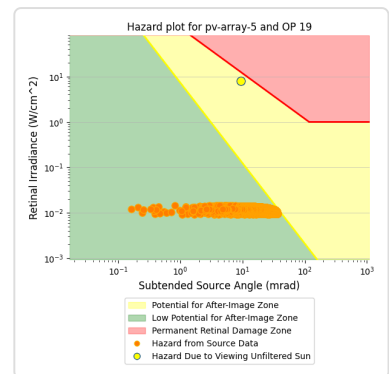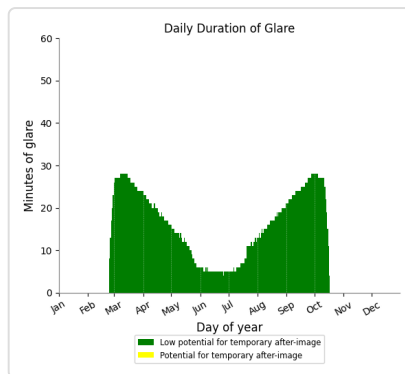

PV array 5: OP 20

PV array is expected to produce the following glare for this receptor:





- 6,758 minutes of "green" glare with low potential to cause temporary after-image.
- 391 minutes of "yellow" glare with potential to cause temporary after-image.

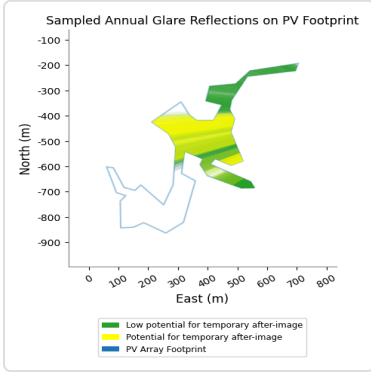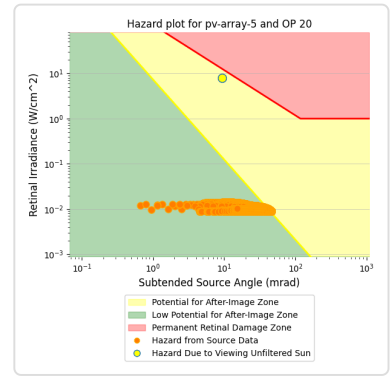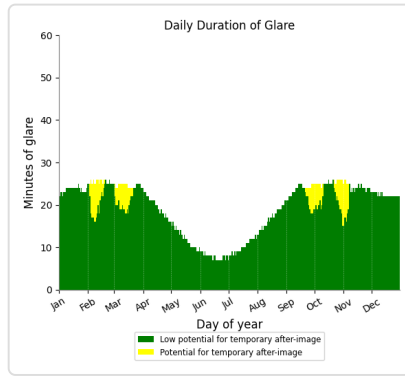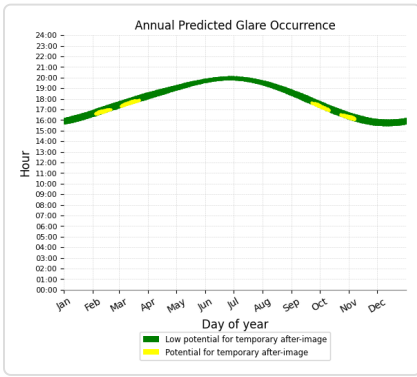

PV array 5: OP 21

PV array is expected to produce the following glare for this receptor:





- 2,865 minutes of "green" glare with low potential to cause temporary after-image.
- 1,494 minutes of "yellow" glare with potential to cause temporary after-image.

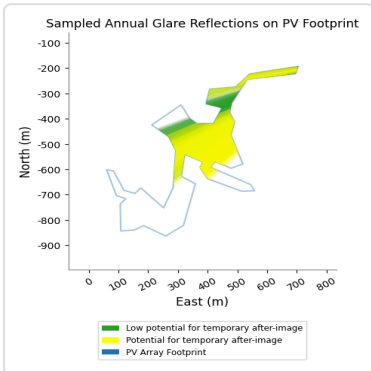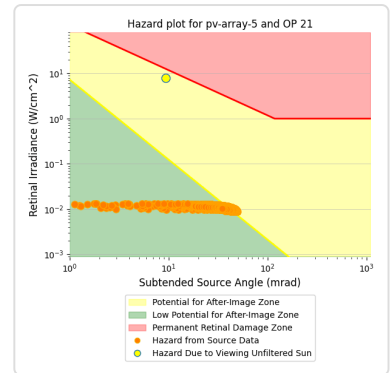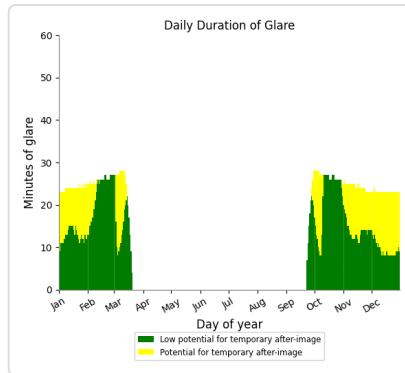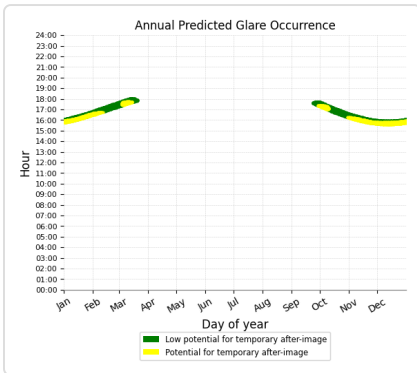

PV array 5: OP 22

PV array is expected to produce the following glare for this receptor:

- 1,322 minutes of "green" glare with low potential to cause temporary after-image.
- 533 minutes of "yellow" glare with potential to cause temporary after-image.

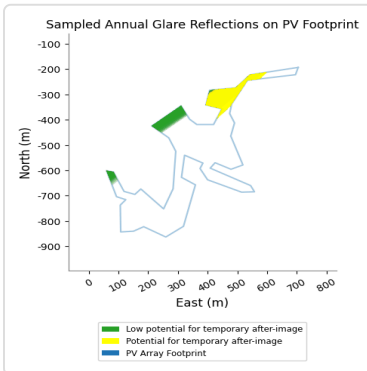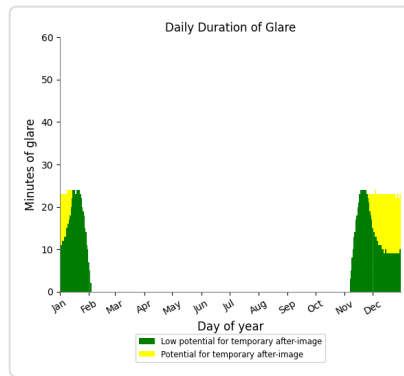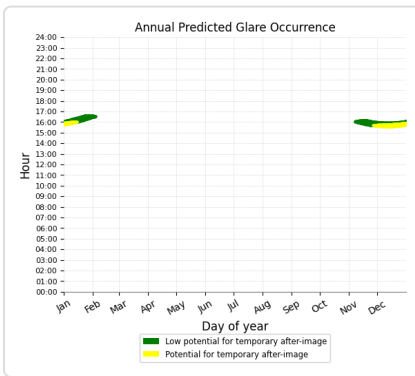

PV array 5: OP 23

No glare found

PV array 5: OP 24

No glare found

PV array 5: OP 25

No glare found

Summary of Vertical Surface Glare Analysis

Assumptions

- Times associated with glare are denoted in Standard time. For Daylight Savings, add one hour.
- Glare analyses do not automatically account for physical obstructions between reflectors and receptors. This includes buildings, tree cover and geographic obstructions.
- Detailed system geometry is not rigorously simulated.
- The glare hazard determination relies on several approximations including observer eye characteristics, angle of view, and typical blink response time. Actual values and results may vary.
- The system output calculation is a DNI-based approximation that assumes clear, sunny skies year-round. It should not be used in place of more rigorous modeling methods.
- Several V1 calculations utilize the PV array centroid, rather than the actual glare spot location, due to algorithm limitations. This may affect results for large PV footprints. Additional analyses of array sub-sections can provide additional information on expected glare.
- The subtended source angle (glare spot size) is constrained by the PV array footprint size. Partitioning large arrays into smaller sections will reduce the maximum potential subtended angle, potentially impacting results if actual glare spots are larger than the sub-array size. Additional analyses of the combined area of adjacent sub-arrays can provide more information on potential glare hazards. (See previous point on related limitations.)
- Hazard zone boundaries shown in the Glare Hazard plot are an approximation and visual aid. Actual ocular impact outcomes encompass a continuous, not discrete, spectrum.
- Glare locations displayed on receptor plots are approximate. Actual glare-spot locations may differ.
- Refer to the **Help page** for detailed assumptions and limitations not listed here.

